


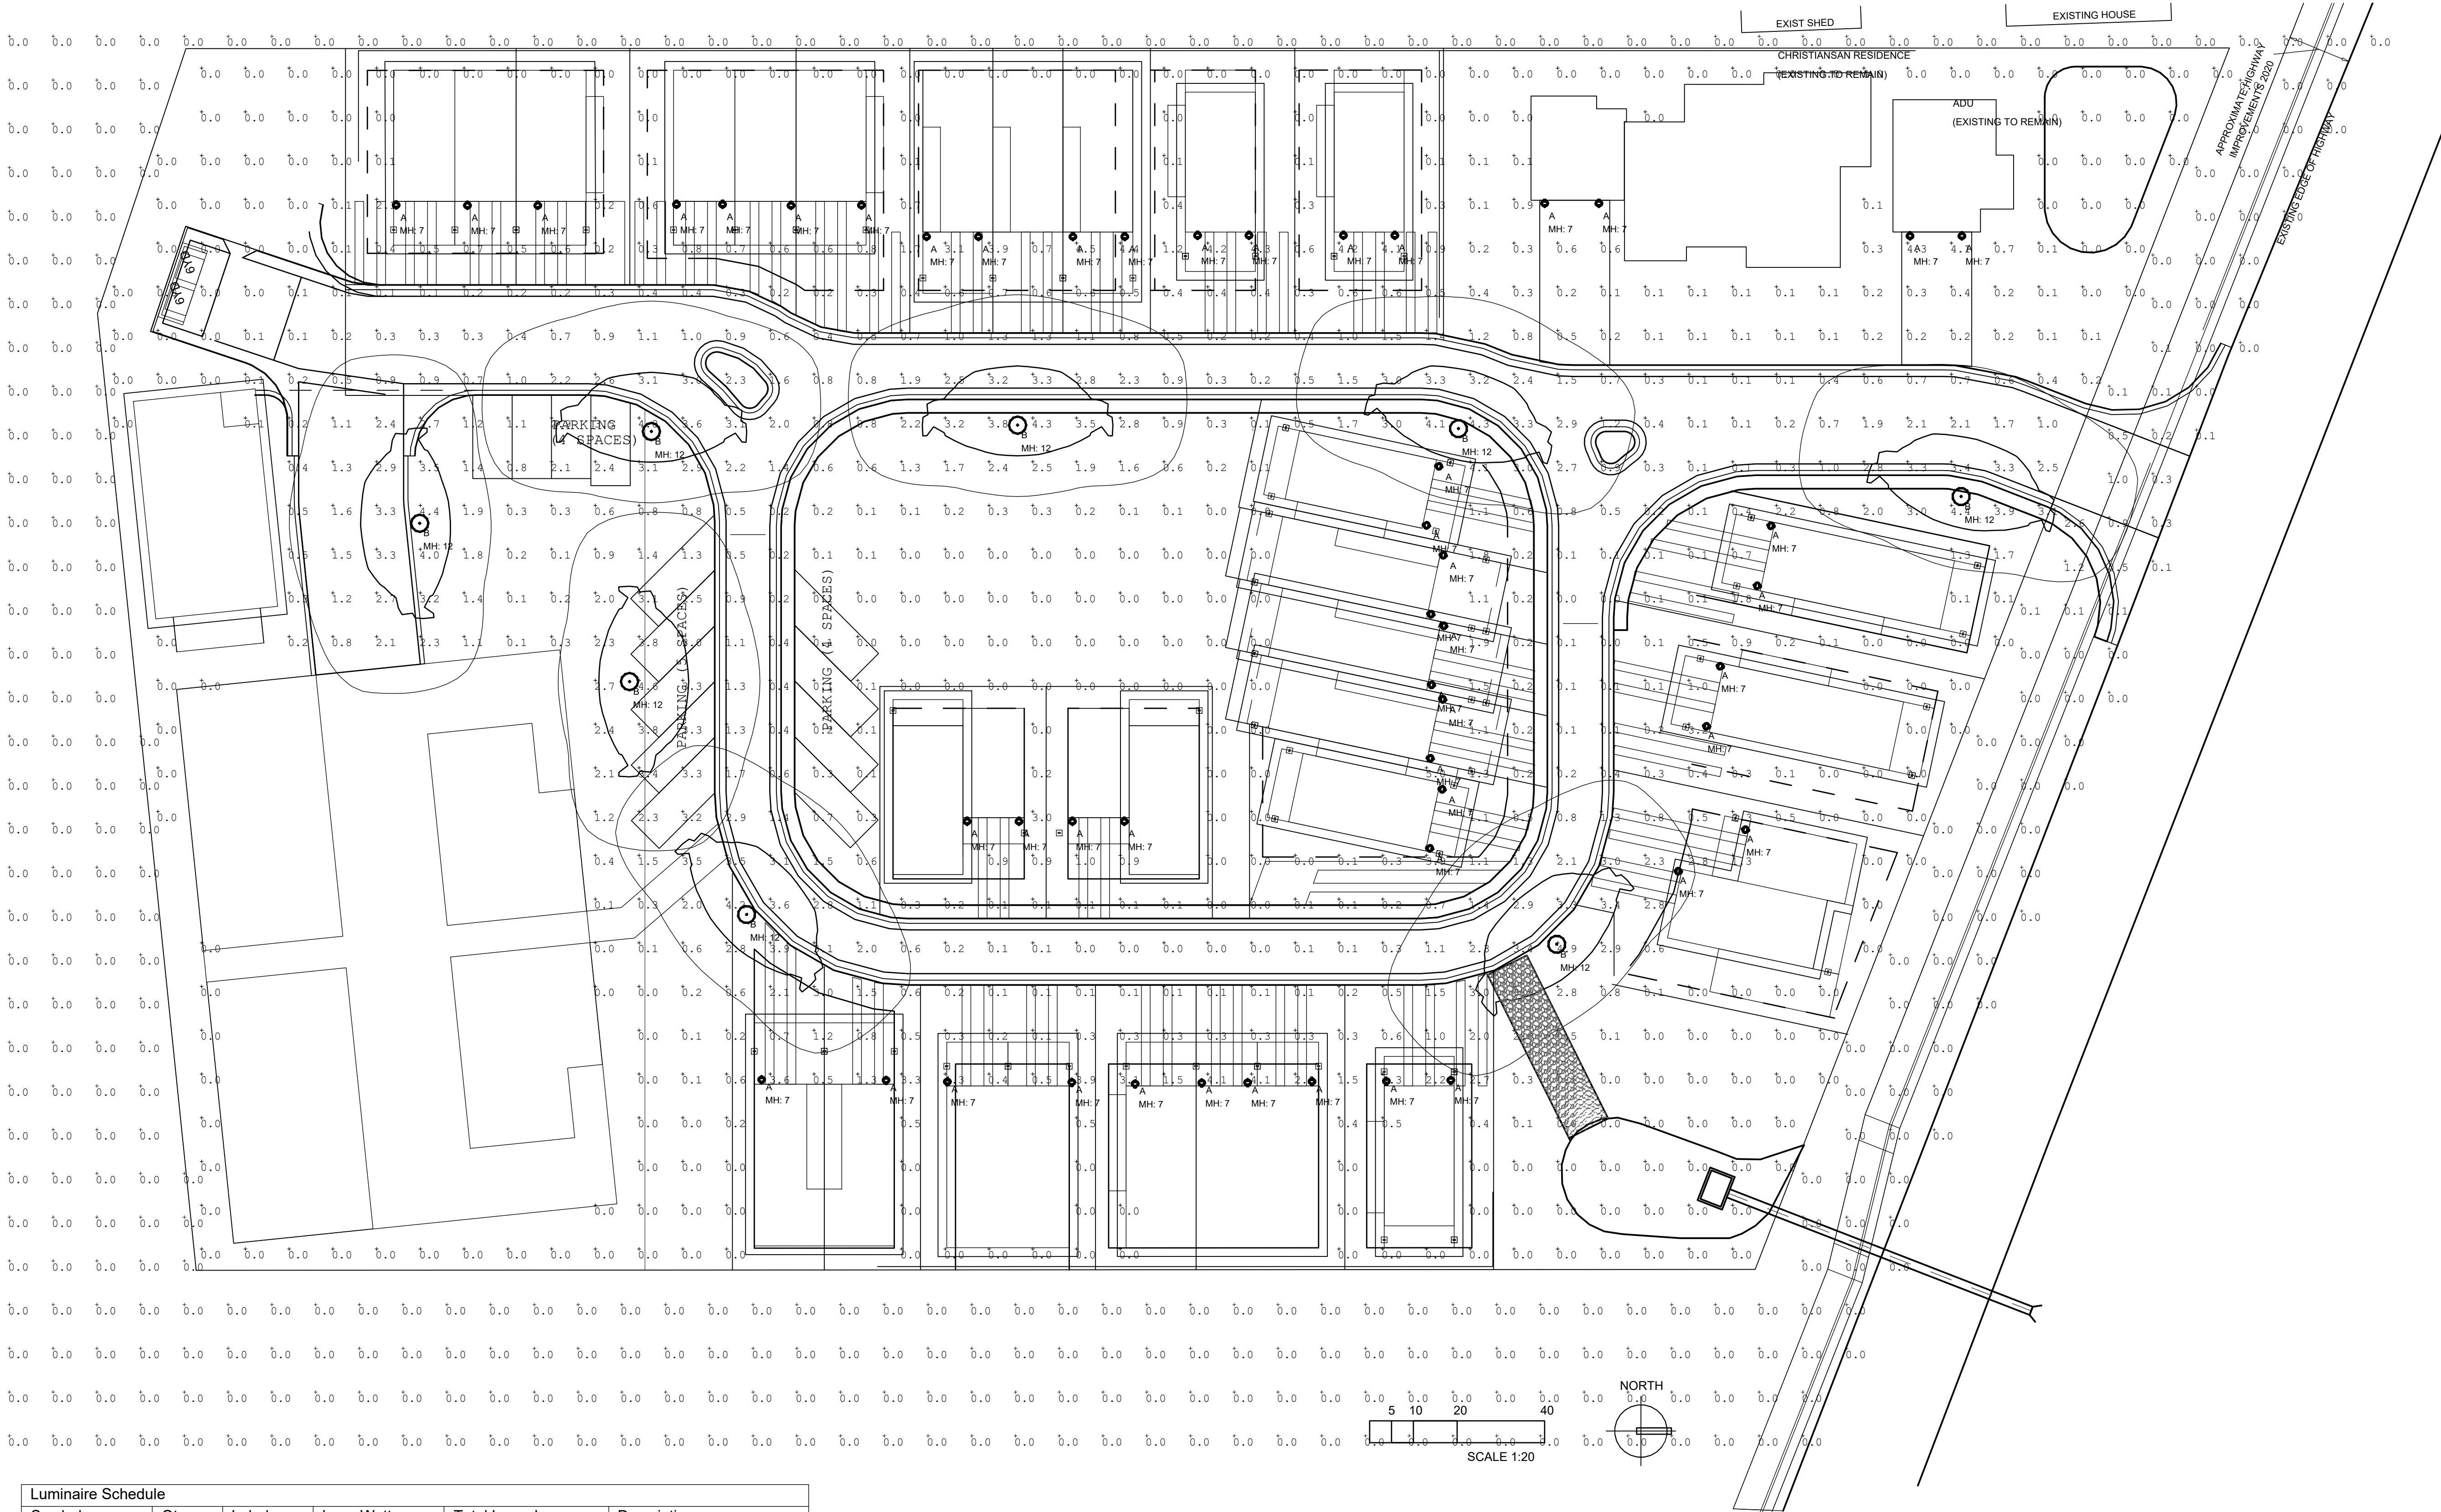

Luminaire Schedule					
Symbol	Qty	Label	Lum. Watts	Total Lamp Lumens	Description
	49	A	18	613	7000WASHH9308D
	8	B	78.3	7,272	EMM-F03-LED-E1-T3

Calculation Summary							
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
BEYOND PROPERTY LINE	Illuminance	Fc	0.02	2.6	0.0	N.A.	N.A.
SITE AREA	Illuminance	Fc	0.79	5.0	0.0	N.A.	N.A.

- LIGHTING NOTE:**
- 1) ANY NEWLY PROPOSED LIGHTING FIXTURES INSTALLED ON PRIVATE PROPERTY, ADJACENT TO THE PUBLIC ROW, SHALL BE ORIENTED IN SUCH A MANNER OR LIMITED IN LUMEN OUTPUT TO PREVENT GLARE PROBLEMS AND SHALL NOT EXCEED NATIONAL I.E.S LIGHTING STANDARD FOR DISABILITY GLARE.
 - 2) ALL NEWLY PROPOSED LUMINAIRES ARE DARK SKY COMPLIANT WITH INTEGRAL LED.
 - 3) MAXIMUM FOOTCANDLE IN PHOTOMETRICS IS BELOW ALLOWED MAXIMUM 8.0 FOOTCANDLES.

COPYRIGHT

Belden Place PUD

South Minturn Addition
Lots 29, 31 & 32
Minturn, Colorado

NOT FOR
CONSTRUCTION

DATE	REVISION
11/11/20	Preliminary Plat Submittal

Title:

Sheet: